


EST-1 Process Variable

pH	0.0 pH
Conductivity	0.0 S/m
Voltage	15.1 A
Current	18.6 V
Pump Status	On
Drain Valve	On
Dosing Pump	Off
AC High PH	Normal
Fault	Normal

EST-2 Process Variable

pH	0.0 pH
Conductivity	0.0 S/m
Voltage	0.1 A
Current	2.2 V
Pump Status	On
Drain Valve	On
Dosing Pump	Off
AC High PH	Normal
Fault	Normal

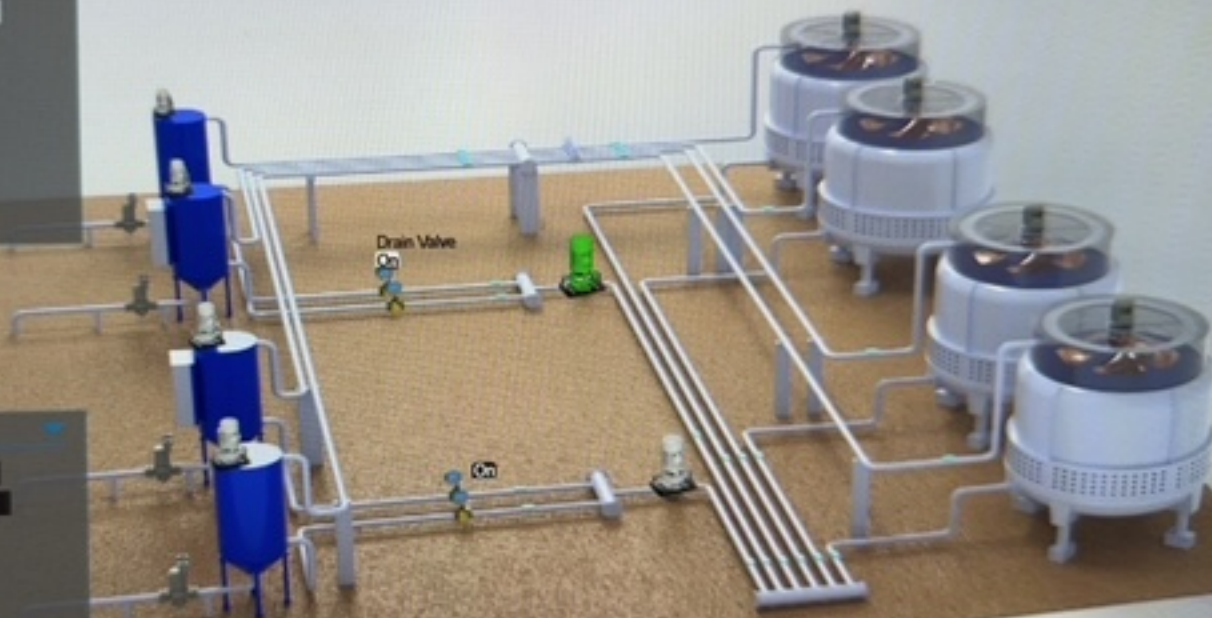

OUTDOOR CONDITIONS
Temp. 28.8 deg C
CHILLED WATER
Sup. 8.5 deg C
Ret. 12.3 deg C